

S.C.

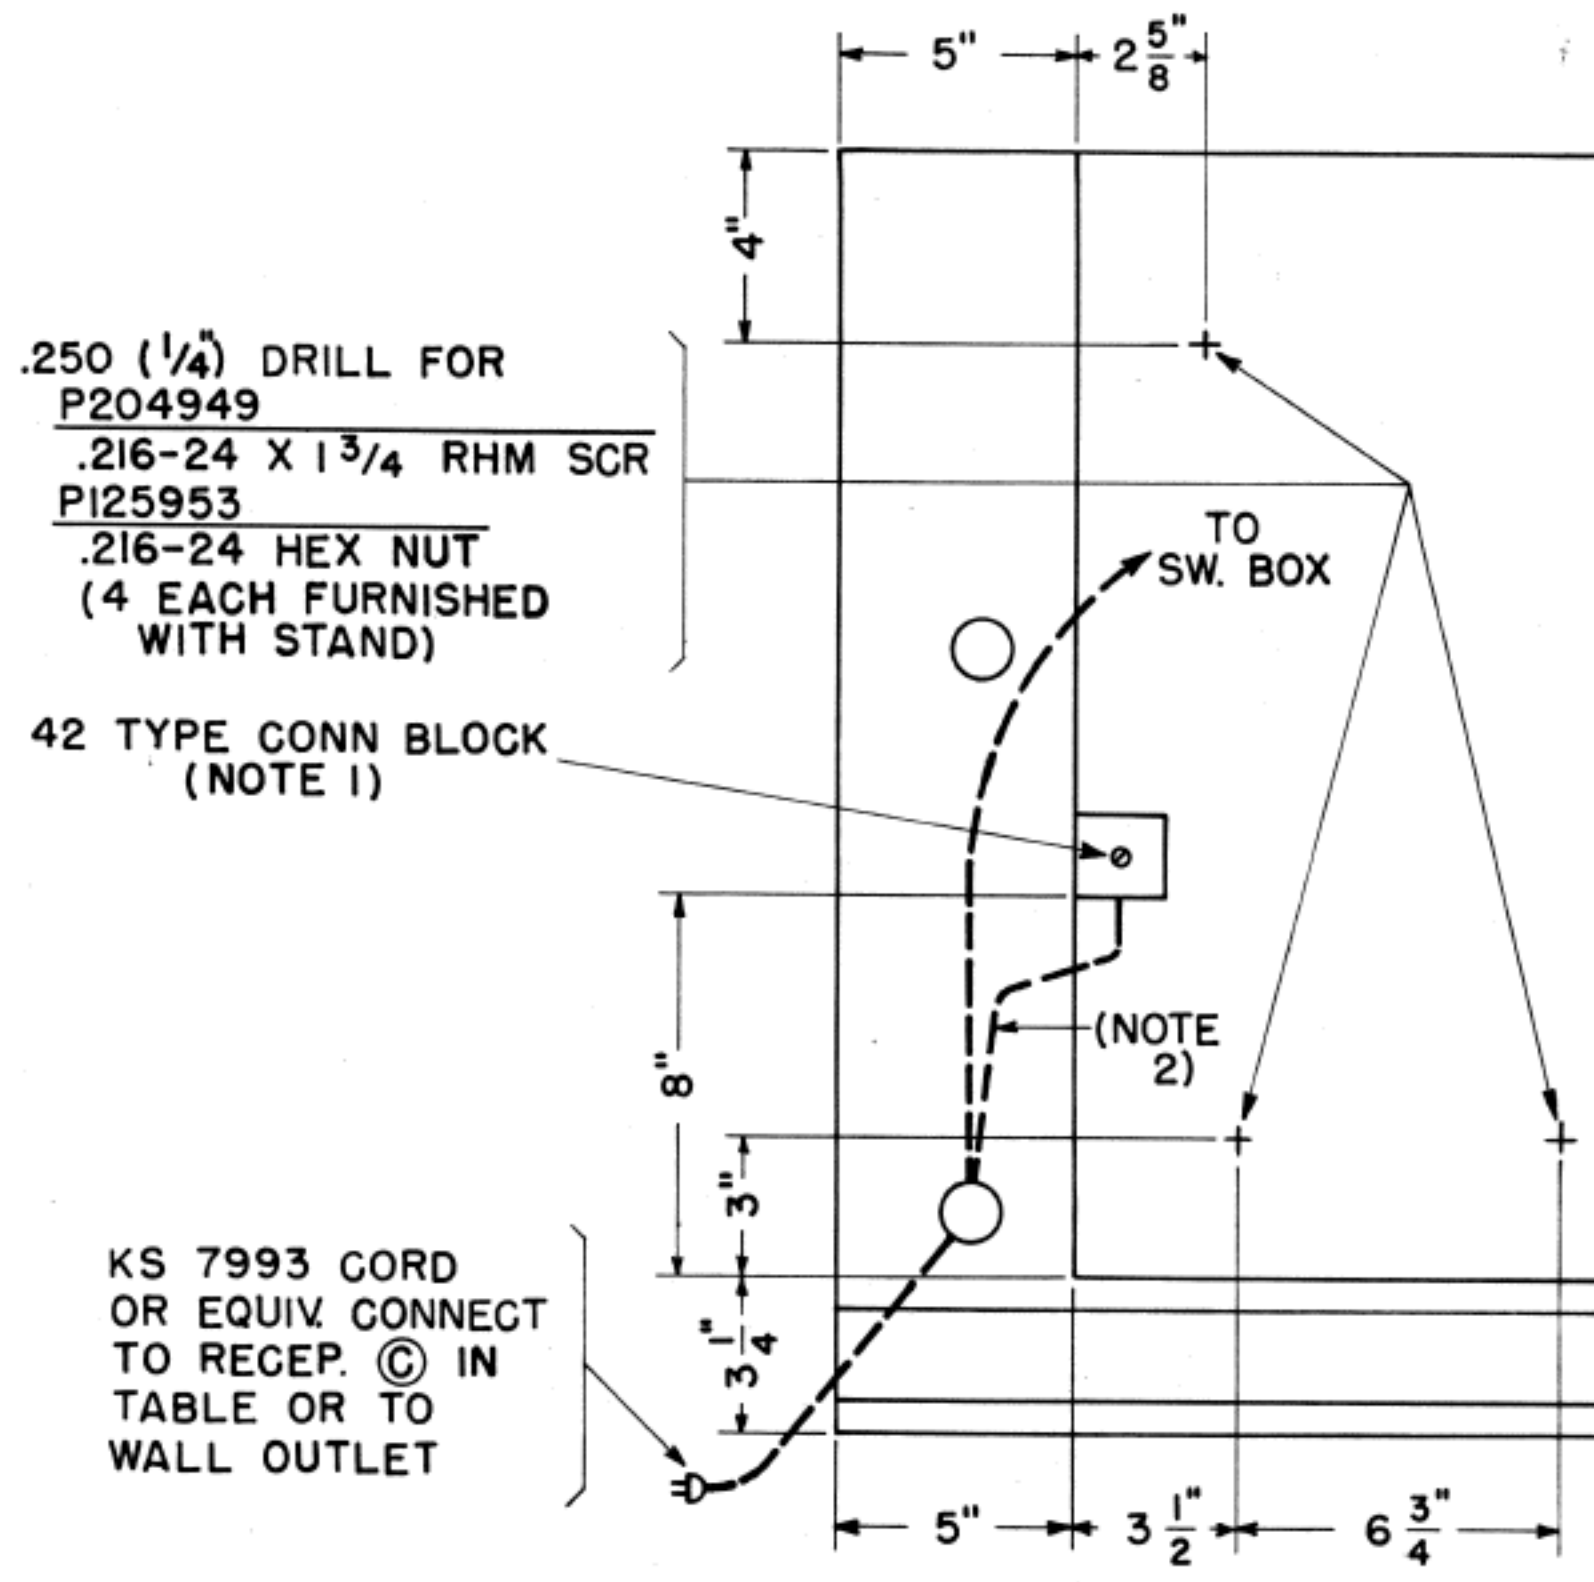


FIG. 3  
ED-70225-01 PANEL  
WITH  
128 OR 130 TYPE SUB. S  
MOUNTED ON  
ED-91296-01 FLOOR STA

- NOTES:
1. REFINISH TO MATCH OTHER EQUIPMENT OR AS SPECIFIED.
  2. INSIDE "C" BROWN CABLE OR EQUIV.

BELL SYSTEM PRACTICES  
TELETYPEWRITER STATIONS

ADDENDUM P90.018  
ISSUE A MAR. 1954  
LONG LINES DEPT.

REPRODUCED FROM SM-10246

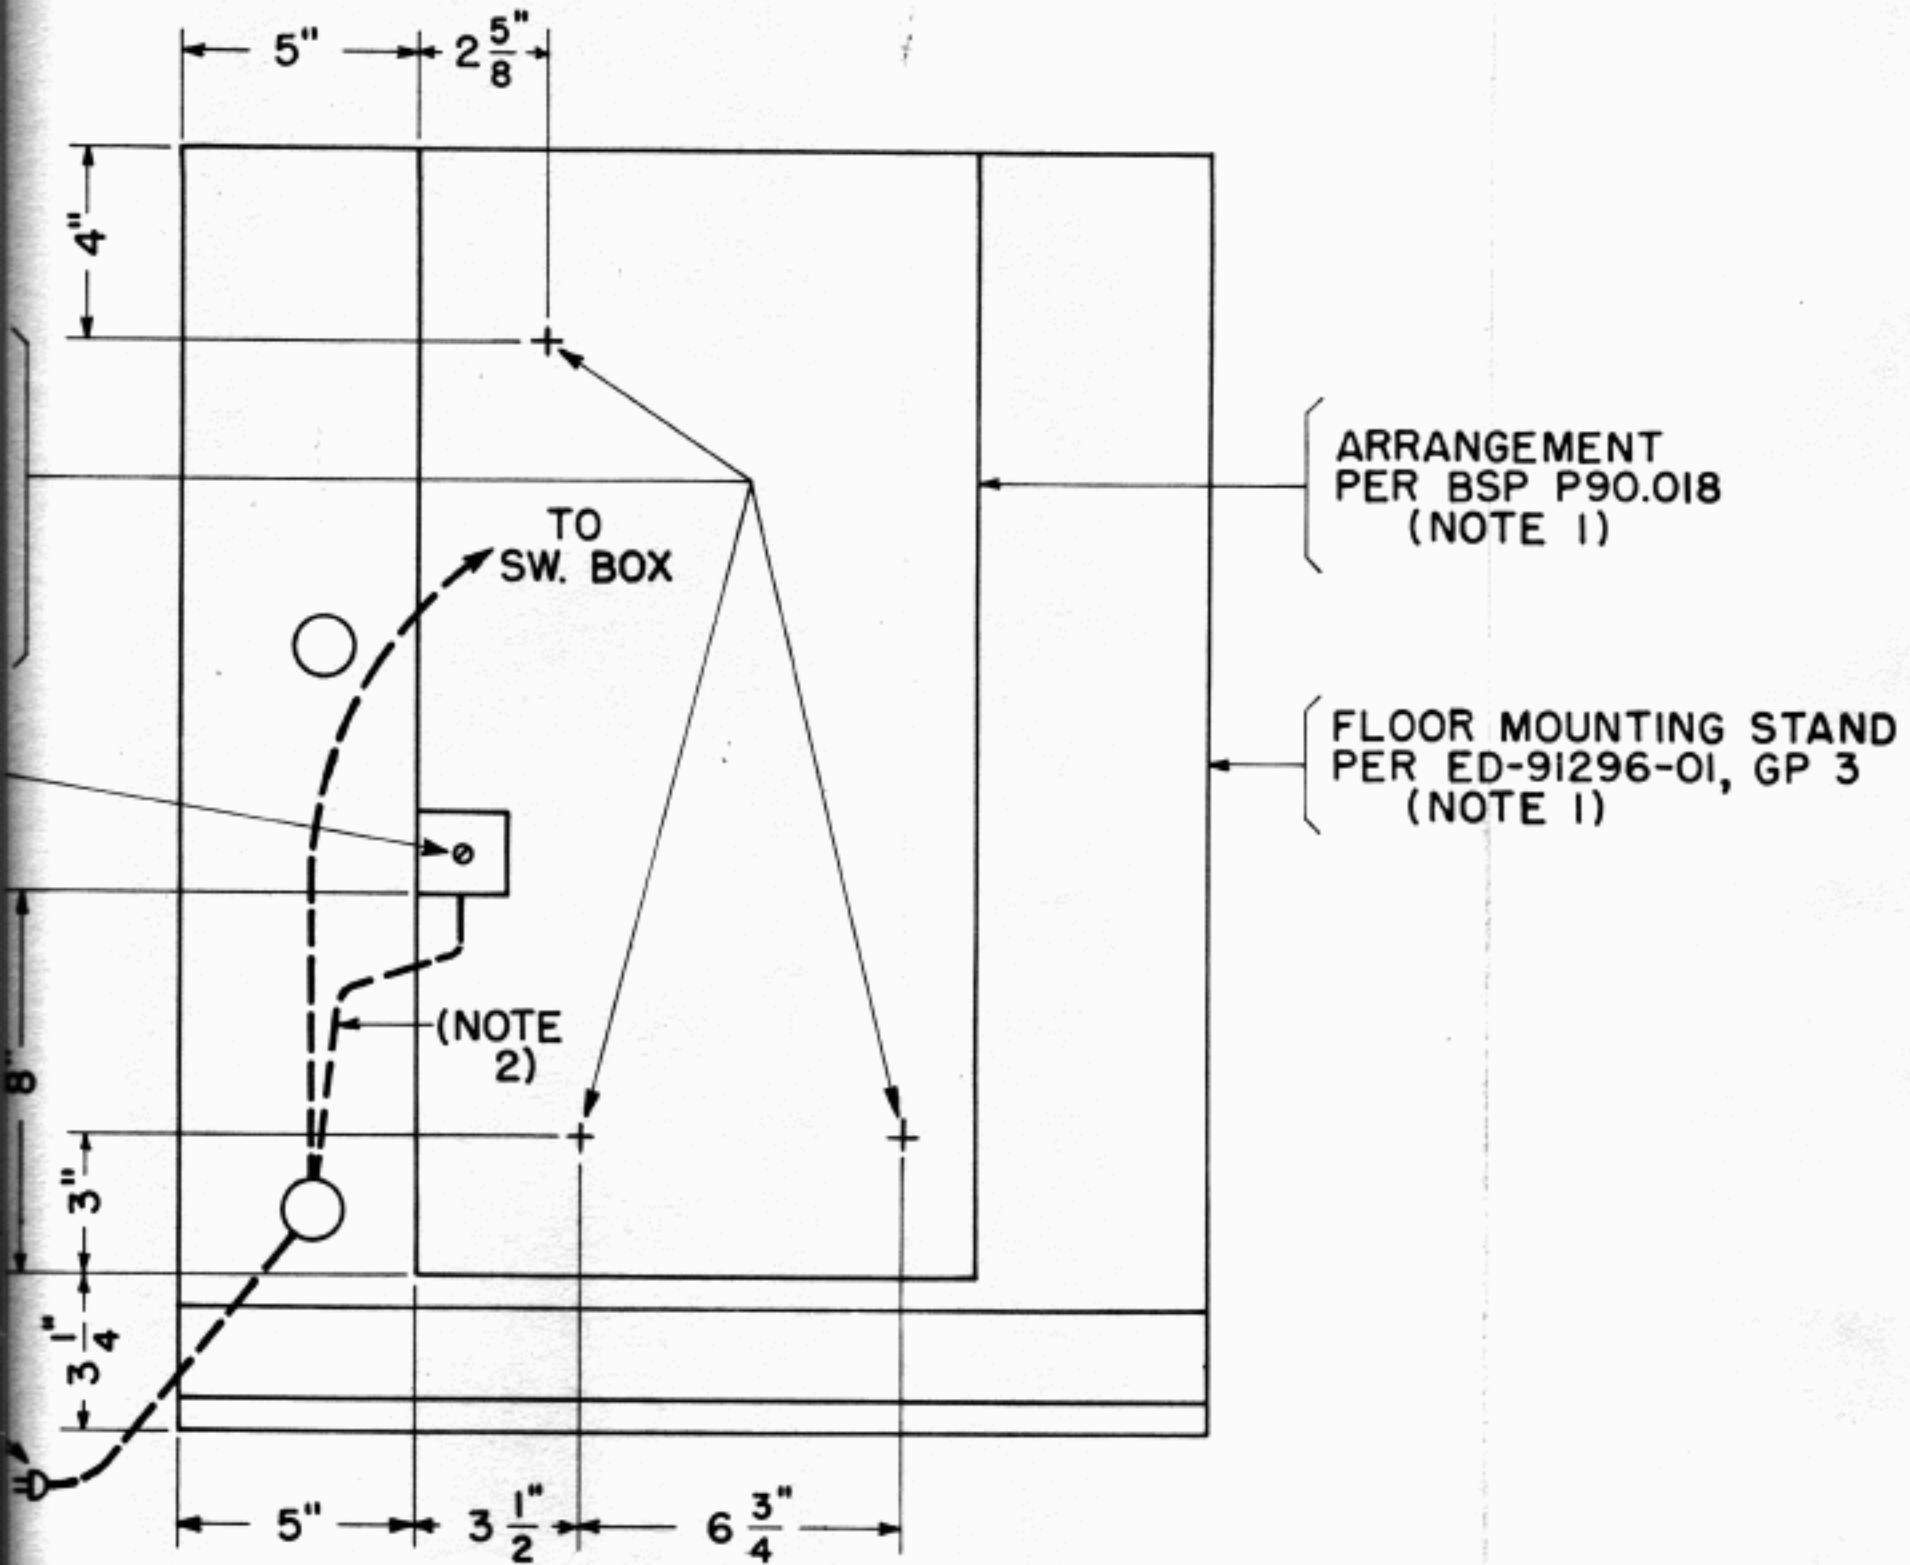


FIG. 3  
ED-70225-01 PANEL  
WITH  
128 OR 130 TYPE SUB. SET  
MOUNTED ON  
ED-91296-01 FLOOR STAND

128B2 OR 130BI TTY SUB. SET  
ARRANGED FOR MOUNTING ON  
FLOOR MOUNTING STAND  
PER ED-91296-01, GP 3

OTHER  
PECIFIED.  
BLE OR EQUIV.