



NOTES: THESE OPERATING PROCEDURES, SPECIFICATIONS, OR OTHER DATA ARE USED FOR ANY PURPOSE OTHER THAN IN CONNECTION WITH A SPECIFICALLY RELATED DESIGN. ANY PROCEDURE INCLUDING THE ABOVE SHOULD BE APPROVED BY THE PERSONNEL RESPONSIBLE FOR THE DESIGN OF THE EQUIPMENT. THE USER SHALL BE RESPONSIBLE FOR THE PROPER USE OF THE EQUIPMENT. THE USER SHALL BE RESPONSIBLE FOR THE PROPER USE OF THE EQUIPMENT. THE USER SHALL BE RESPONSIBLE FOR THE PROPER USE OF THE EQUIPMENT.

FOR INFORMATION ONLY. CONTRACTOR MAY AT HIS OPTION DEVIATE FROM THESE PROCESS DETAILS.

SWE APPROVAL		REVISIONS			
SYN	PR	BY	DESCRIPTION	DATE	APPROVAL
	PR 10042/13				
		A <sub>3</sub>	A <sub>1</sub> - ADDED ITEM 7, A <sub>2</sub> ADDED NEW APPLICATION, A <sub>3</sub> ITEM 8 DESCRIPTION WAS "CAN"	20 NOV 59	PME
		B	(1) ADDED NOTE 11.	10 NOV 60	PME
		C <sub>1</sub>	(1) ± 1% WAS ± .1%	26 MAR 1965	PME

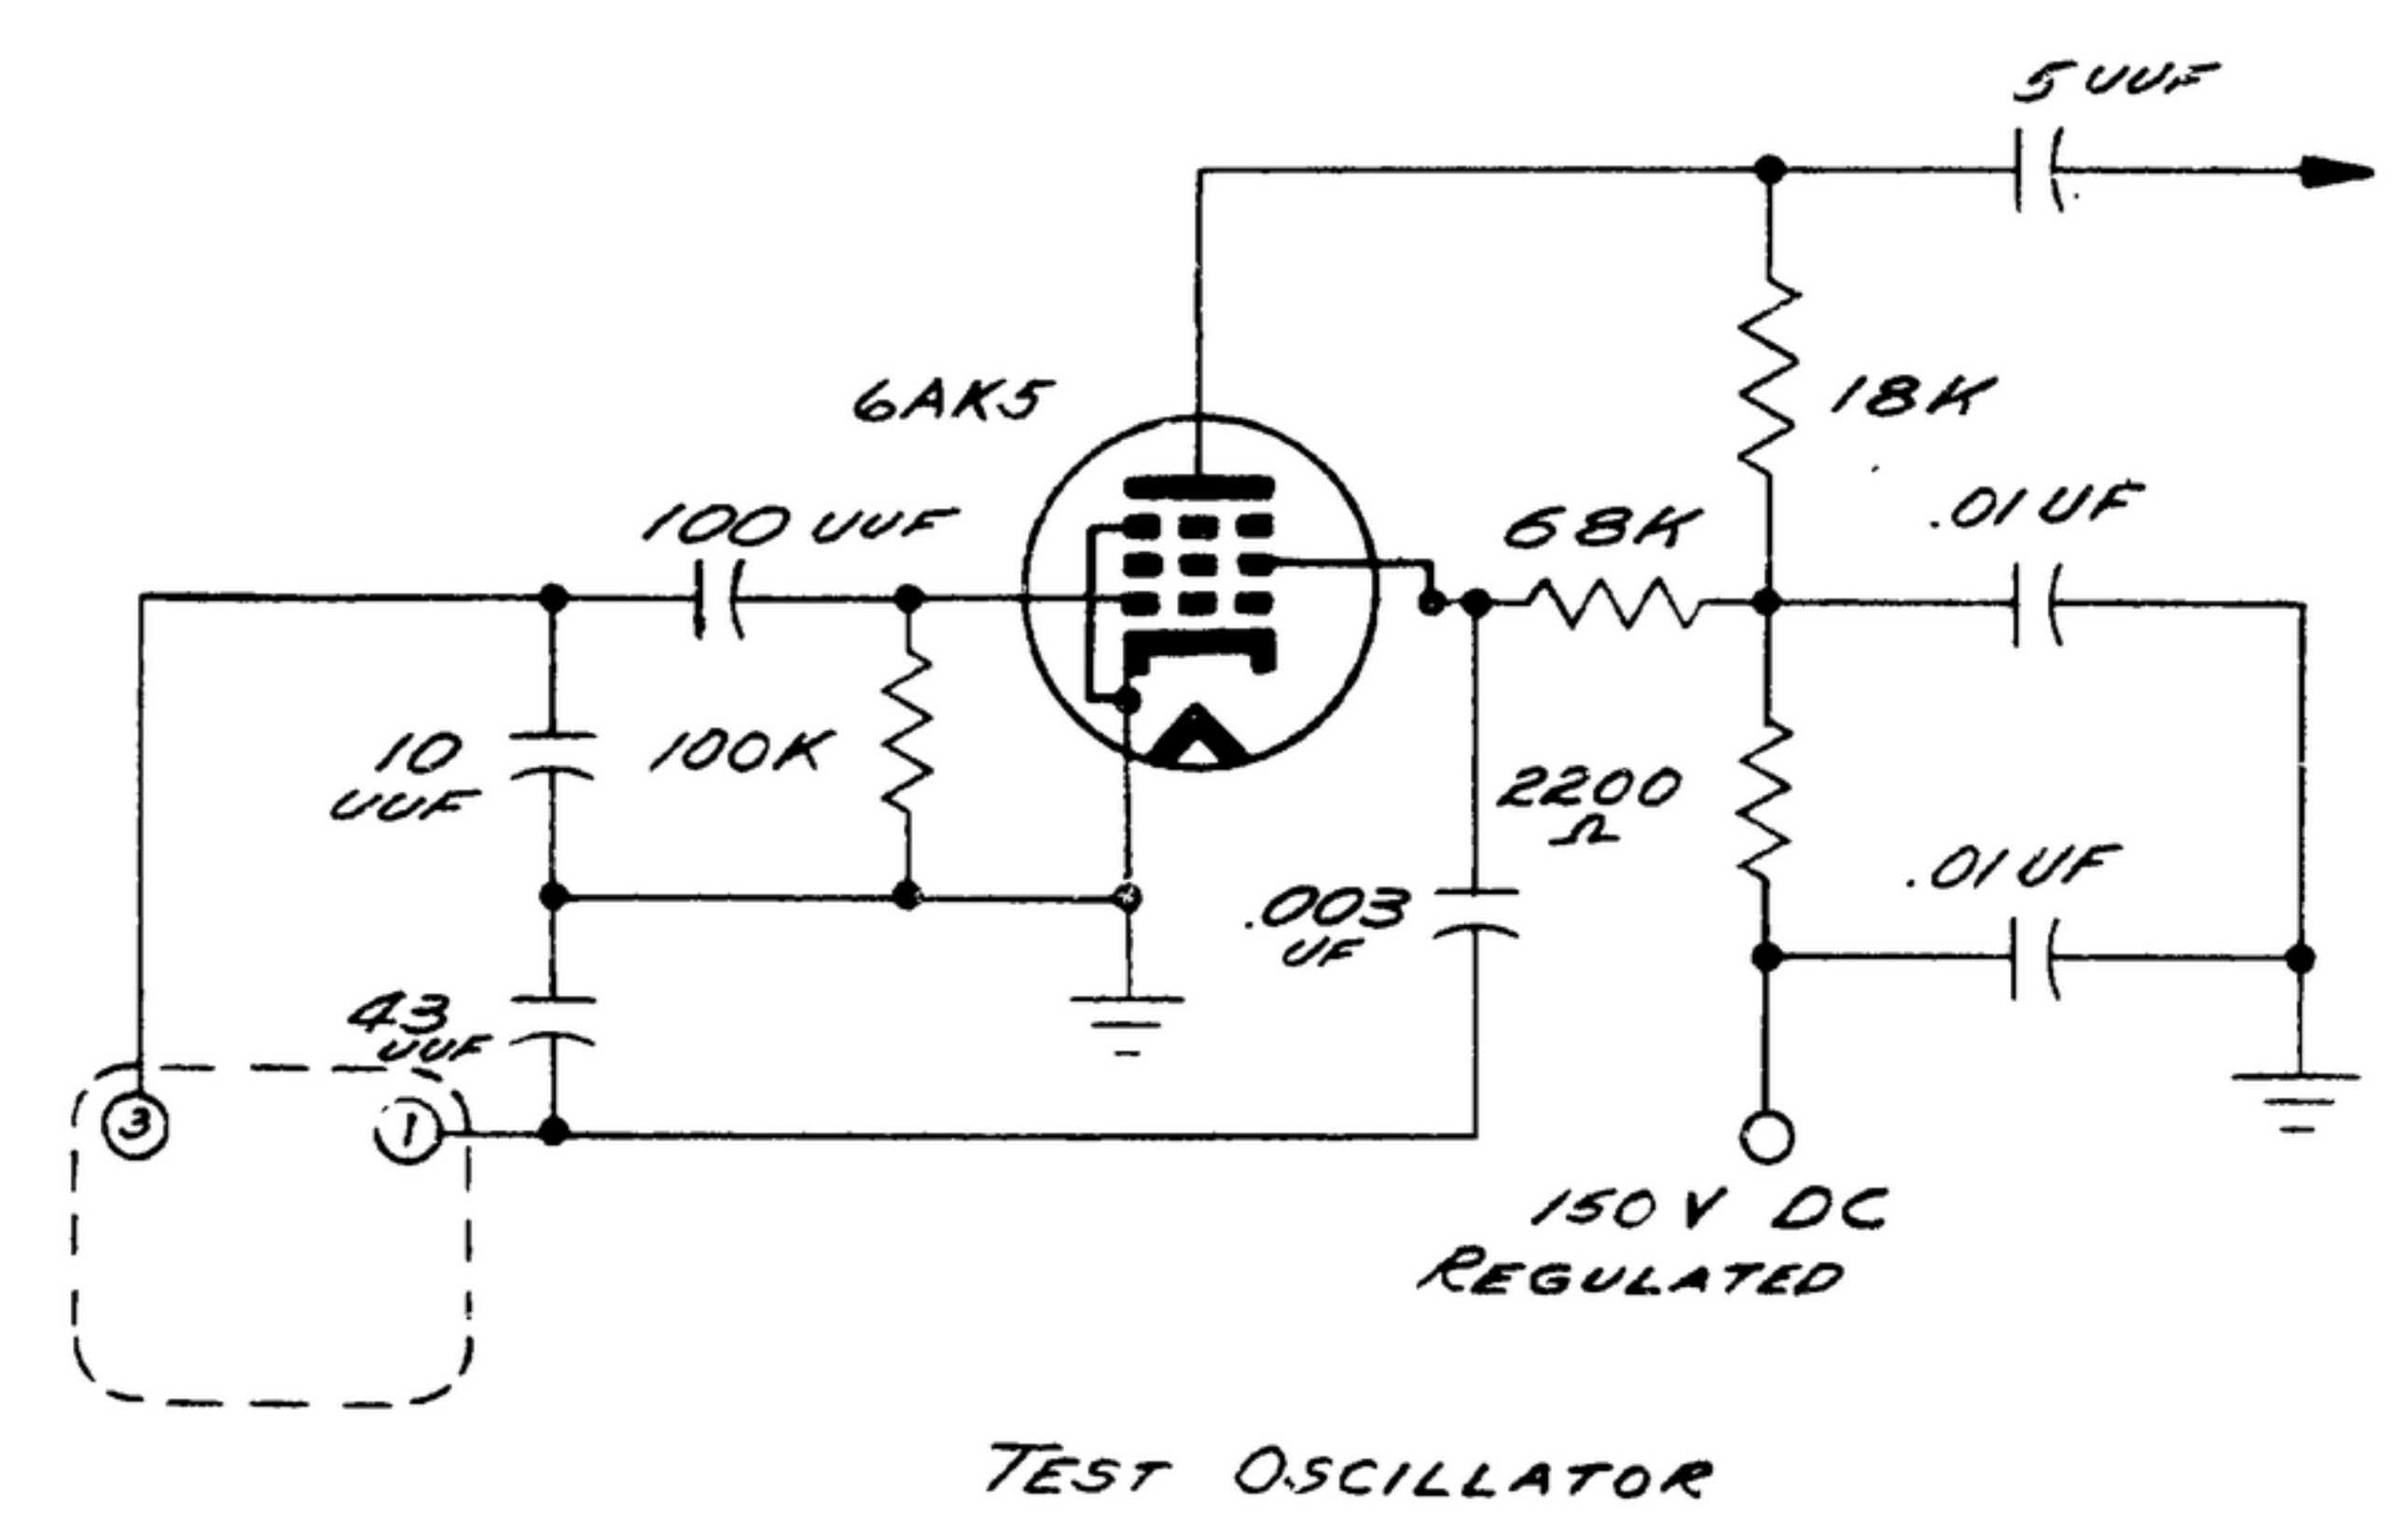




TEST OSCILLATOR

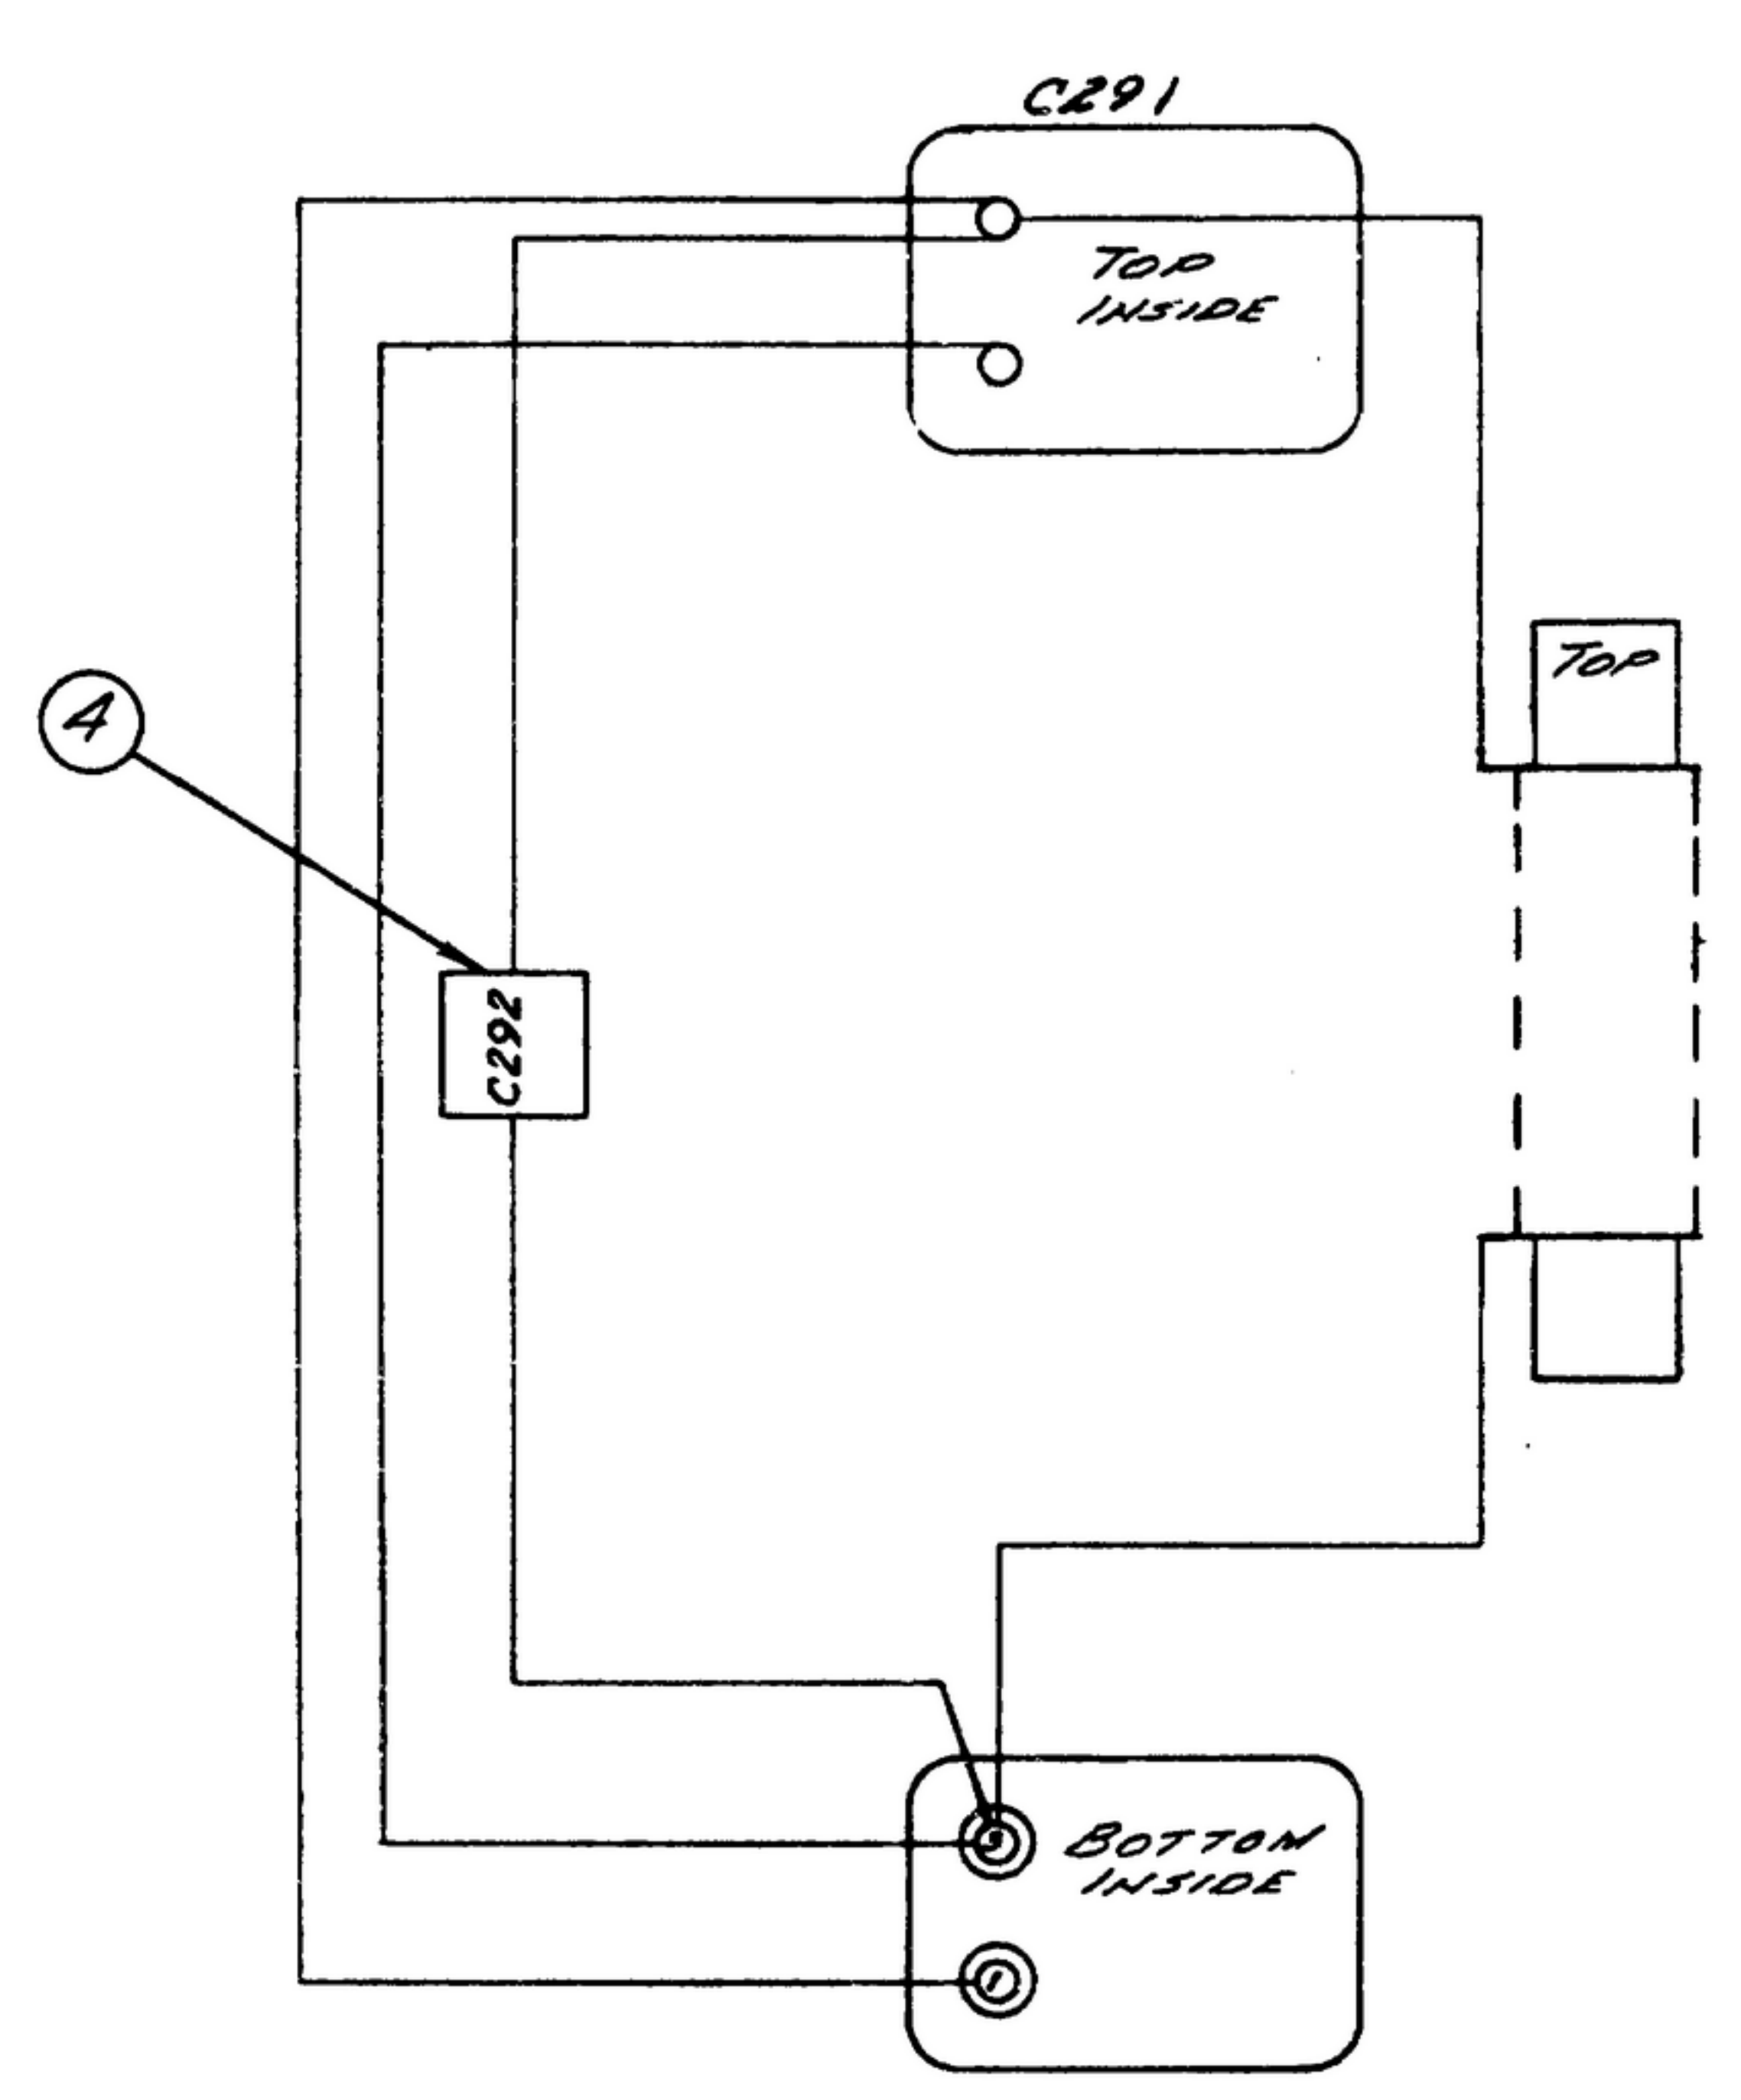

WIRING DIAGRAM

CORE POSITION INCHES ±.0002	TEST OSC FREQ MC	FREQ Tol KC	EFFECTIVE PARALLEL RESISTANCE (OHMS) ±.25%
-0.0300	3.0375	18	
0.0000	3.00	12	25000
± 0.0800	2.90		
0.1600	2.80	12	
0.2400	2.70	12	
0.3200	2.60	12	
0.4000	2.50	12	35000
0.4800	2.40	12	
0.5600	2.30	12	
0.6400	2.20	12	
± 0.7200	2.10		
0.8000	2.00	12	45000
0.8300	1.9525	18	

± ALIGNMENT POINTS SEE NOTE 4

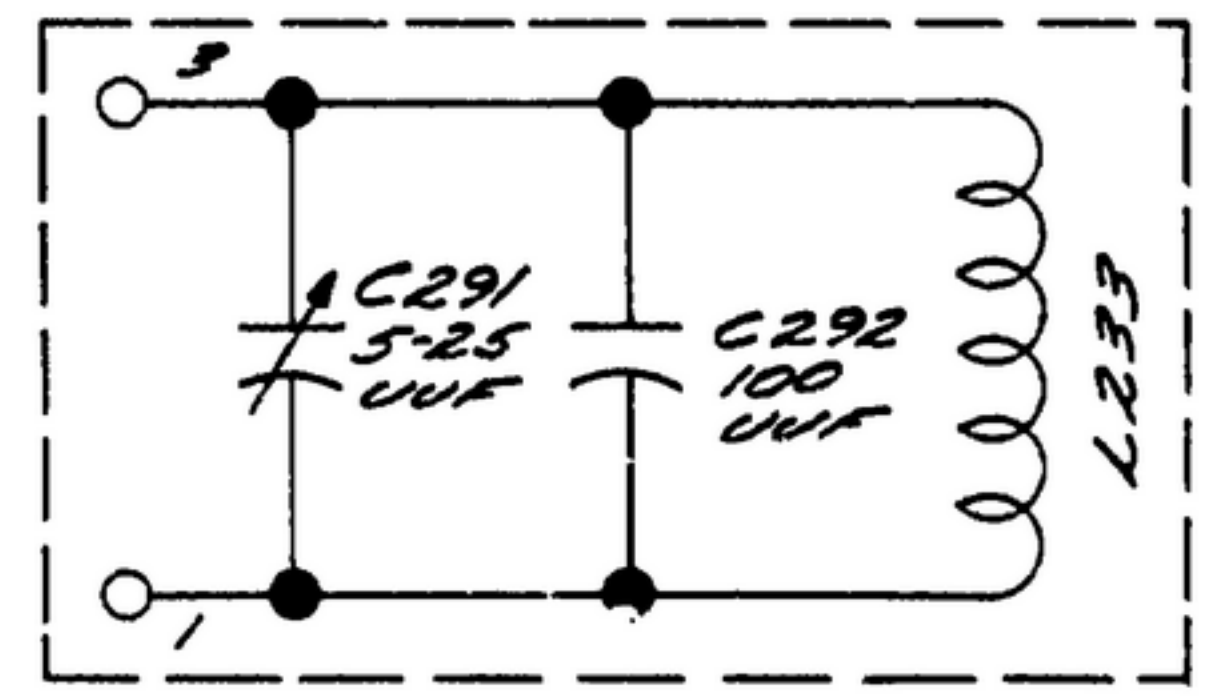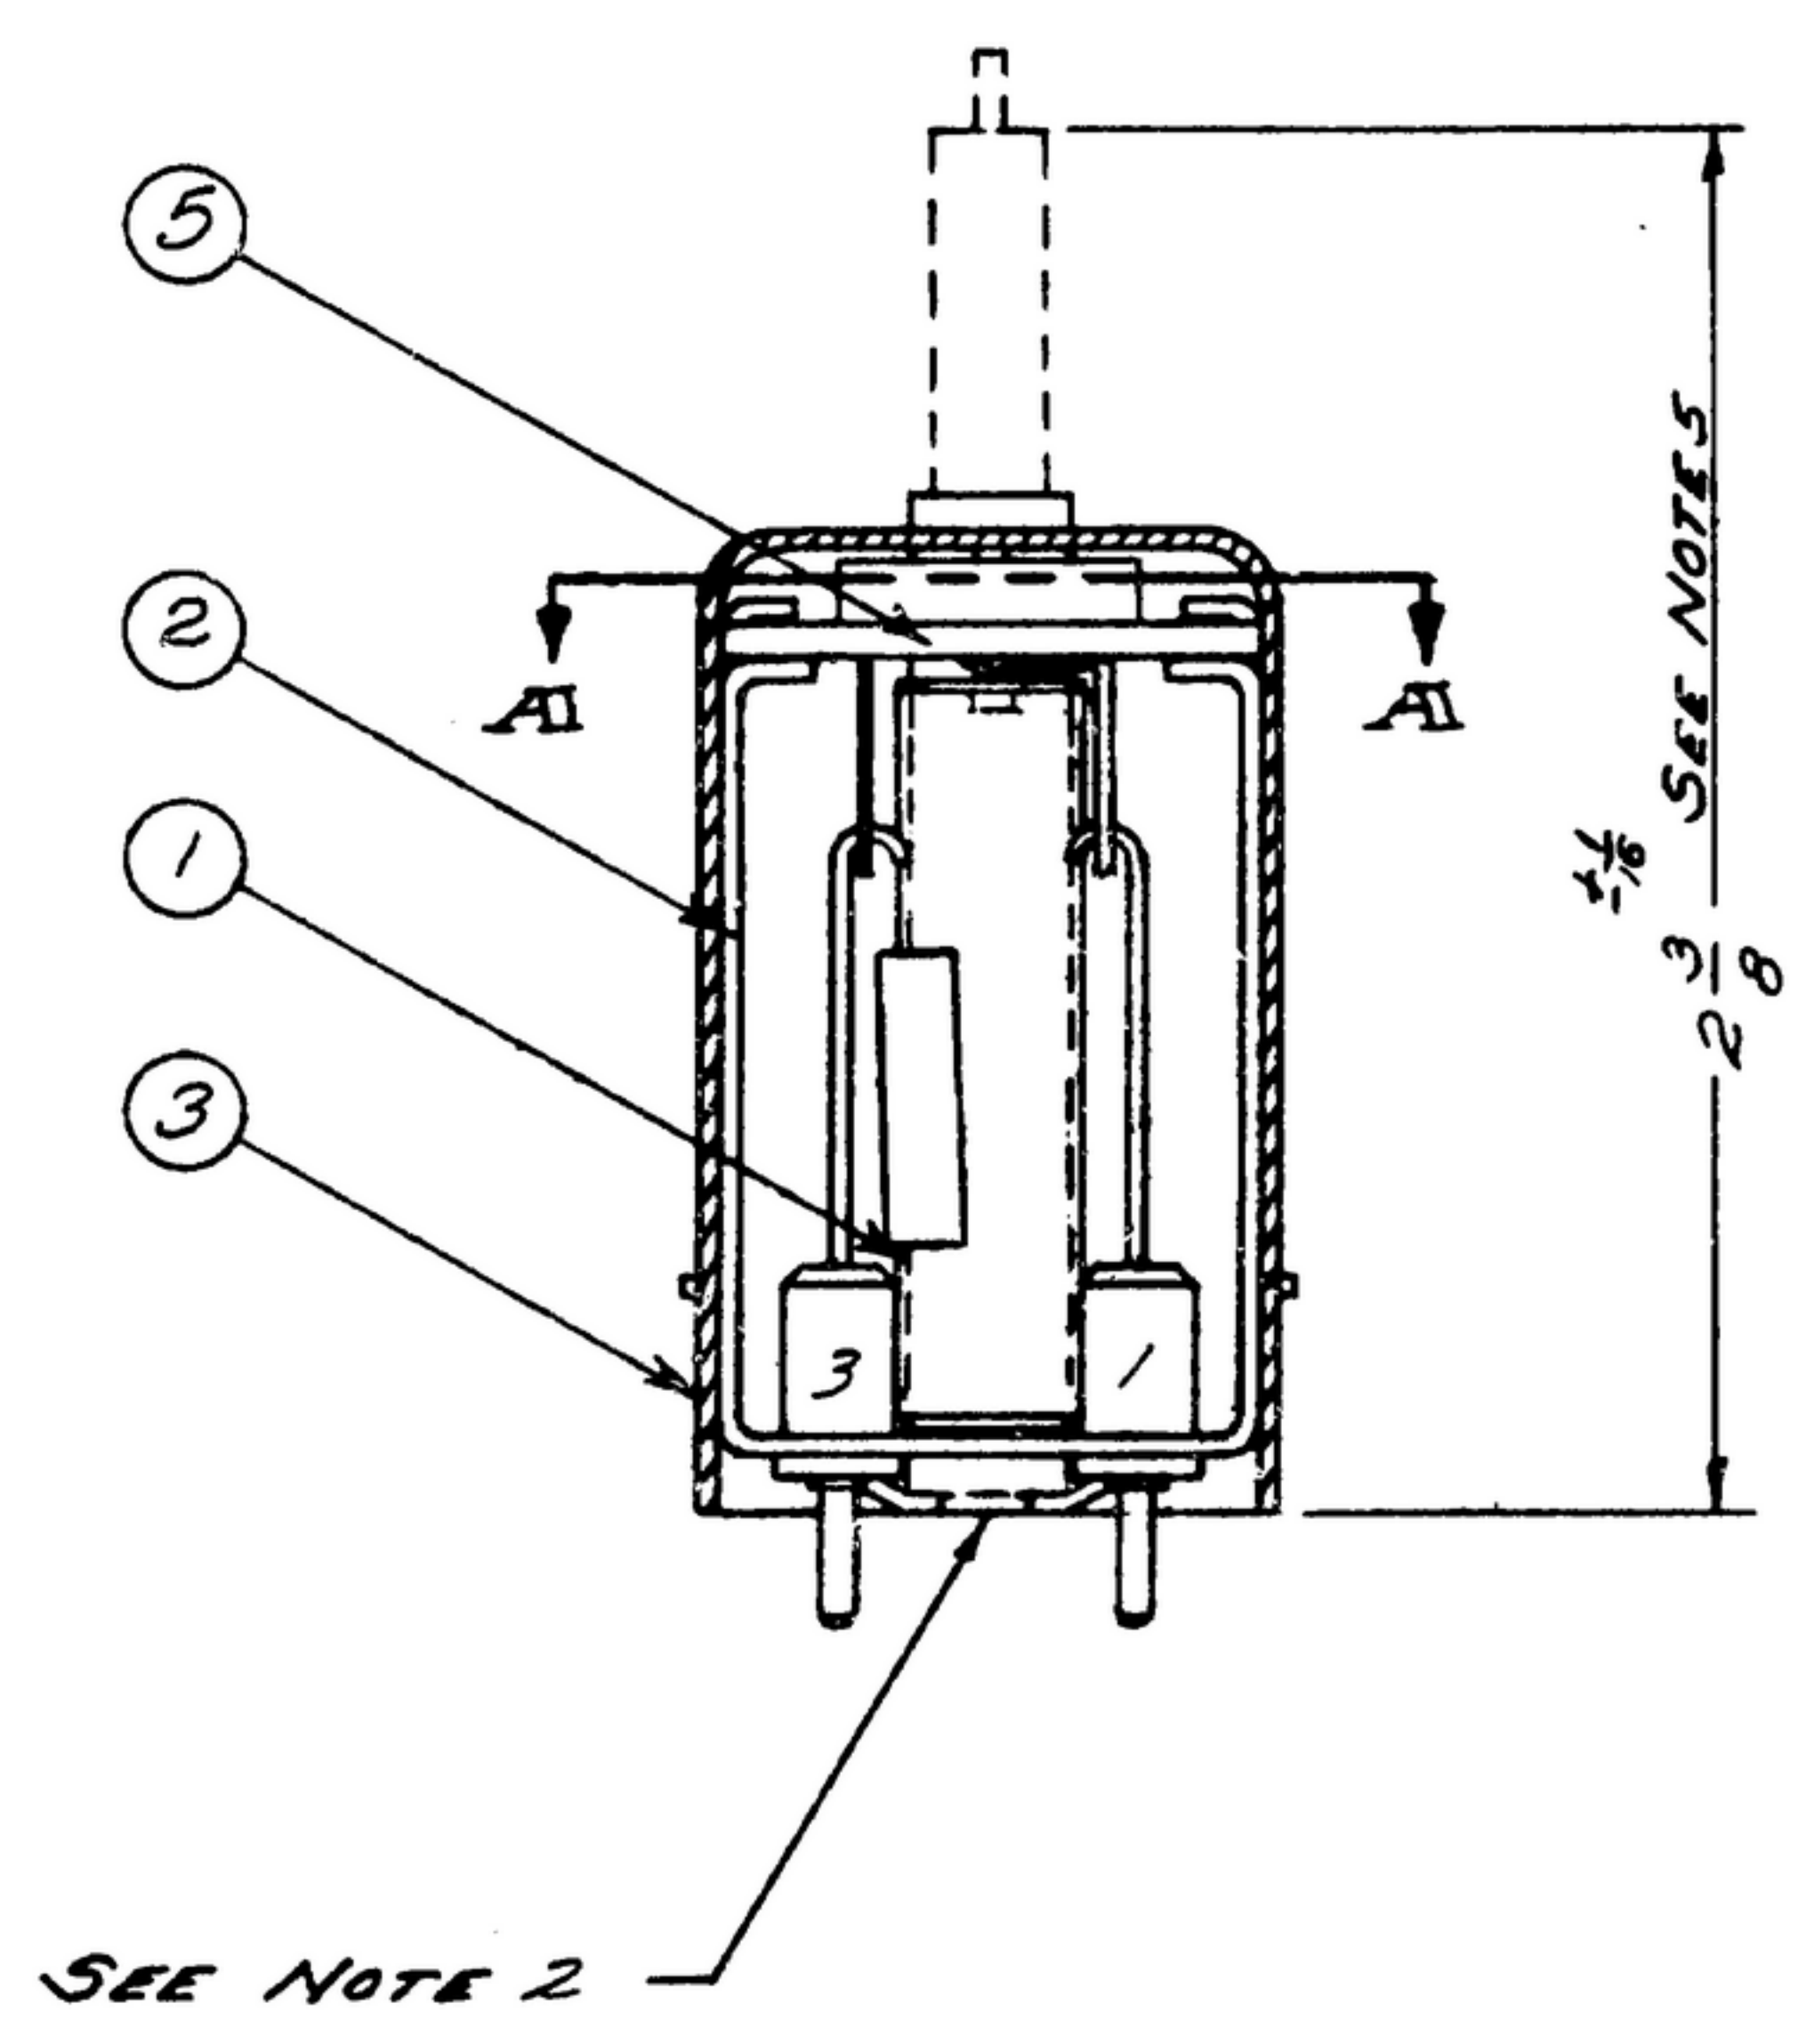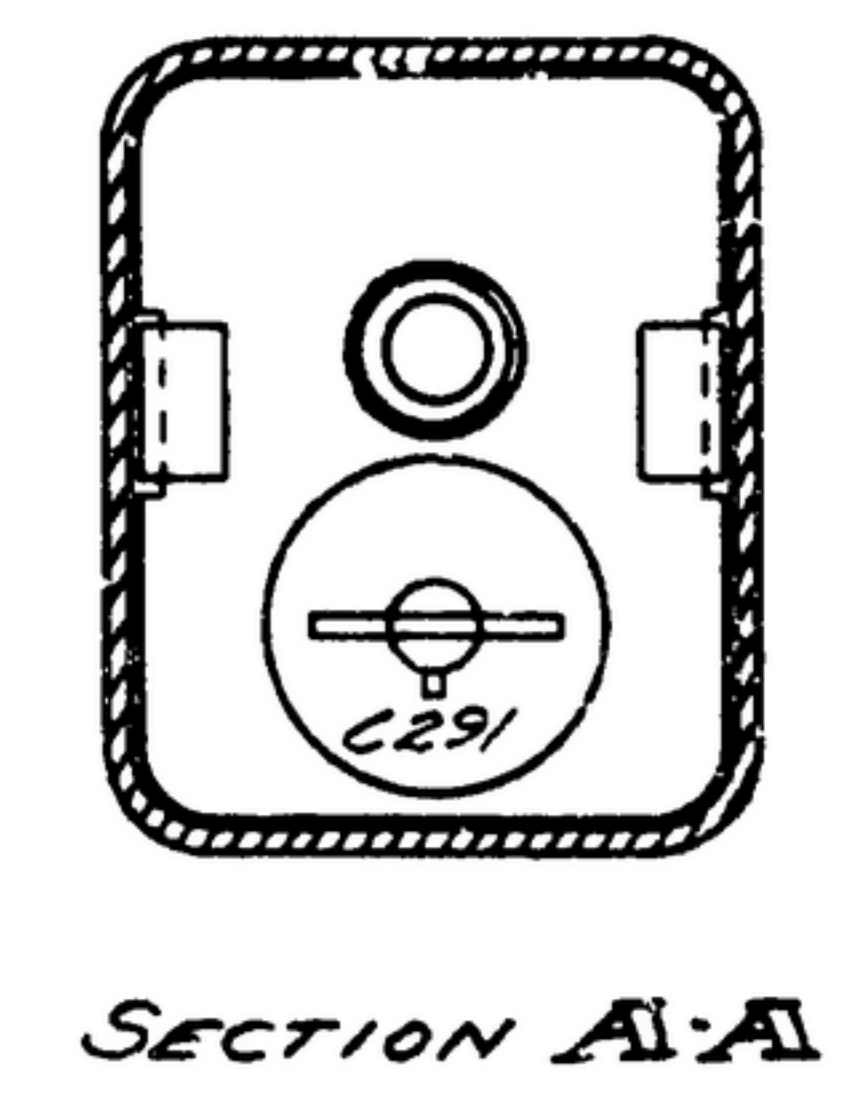

SCHEMATIC DIAGRAM OF COIL R554

- NOTES:
- SOFT SOLDER PER SPEC MIL-S-6872 USING ROSIN CORE SOLDER (7), COMP. SN 60.
  - COIL FORM OF COIL ASSY (1) TO BE CONCENTRIC WITH .140 DIA HOLE IN FRAME (2) WITHIN .020 T.I.R.
  - MOUNTING POSITION OF CAPACITOR OPTIONAL, PROVIDING NO CAPACITOR COMES WITHIN 1/16 OF COIL WINDING.
  - ALIGNMENT: WITH COIL R554 IN TEST JIG, AND STANDARD POWDERED IRON TUNING CORE POSITIONED IN THE COIL, ADJUST VARIABLE CAPACITOR (5), UNTIL TEST OSCILLATOR FREQUENCY IS WITHIN 500 CPS OF THE VALUE SHOWN IN TABLE AT TWO ALIGNMENT POINTS. THE FINAL SETTING OF THE VARIABLE CAPACITOR (5) SHALL LEAVE A RESERVE ADJUSTMENT OF 2MMT.
  - BROKEN LINES INDICATE OUTLINE OF STANDARD POWDERED IRON TUNING CORE OF TEST JIG. DIMENSION APPLIES TO THE CORE IN 0.0800 ALIGNMENT POSITION AFTER ELECTRICAL ALIGNMENT PER NOTE 4.
  - TRACKING: TEST OSCILLATOR FREQUENCY SHALL BE WITHIN THE TOLERANCE OF TABLE AT SPECIFIED CORE INSERTIONS AT 25°C.
  - STABILITY: THE RESONANT FREQUENCY OF THE TUNING COIL SHALL VARY NO MORE THAN 40 PPM/°C FROM THE 25°C VALUE OVER THE SPECIFIED TEMPERATURE RANGE.
  - TEMPERATURE RANGE: -40°C TO +85°C OPERATING, -62°C TO +85°C STORAGE.
  - THE COIL ASSY SHALL BE BONDED TO THE BASE PLATE AND TO THE VARIABLE CAPACITOR BOARD TOP (5) WITH BONDING AGENT (6) 5R313 AS SUPPLIED BY CARL H. BIGGS CO, LOS ANGELES CALIF. OR EQUAL.
  - HUMIDITY: UNIT SHALL BE CAPABLE OF OPERATION AFTER EXPOSURE TO 5 HUMIDITY CYCLES CONDUCTED IN ACCORDANCE WITH THE LATEST VERSION OF SIGNAL CORPS DRAWING SC-DL-16286. UPON COMPLETION OF THE HUMIDITY CYCLES THE UNIT SHALL BE ALLOWED TO DRY AT 25°C AMBIENT FOR A PERIOD OF 1 HOUR.
  - TUNING CORE REFERRED TO IN NOTE 5 SHOULD BE SM-C-249244 AND MUST BE WITHIN ± 1% OF NOMINAL PERMEABILITY.

QTY	ITEM	REQD	PART NO.	DESCRIPTION	MATL.	MATL. SPEC.	NOTES
7	AS REQD			SOLDER, SOFT		GR-5-571	1
6	AS REQD			BONDING AGENT			2
5	1		SM-C28320-2	CAPACITOR-VARIABLE			3
4	1		SM-C283226-16	CAPACITOR-FIXED			4
3	1		SM-B-249169	CAN, MARKED			5
2	1		SM-B-249061	FRAME ASSY			6
1	1		SM-B-283281	COIL R554			7

LIST OF MATERIAL

DRAWN <b>NUGEN</b>	CHECKED <b>Rh</b>	APPROVED	DESIGNED-DRAWN-CHKD <b>14214-PH-51-93</b>	REVIEWED <b>PME</b>	APPROVED <b>HLV</b>	DATE <b>22 FEB 56</b>	SCALE <b>2/1</b>	DEPARTMENT OF THE ARMY SIGNAL CORPS ENGINEERING LABORATORIES FORT MONMOUTH NEW JERSEY
UNLESS OTHERWISE SPECIFIED: DECIMAL DIMENSIONS INCLUDING HOLE SIZES MAY VARY ±.005 FRACTIONAL DIMENSIONS INCLUDING HOLE SIZES MAY VARY ±1/64 ROUNDED ANGLES MAY VARY ±.1° SQUARE ANGLES MAY VARY ±.004° BROKEN ANGLES MAY VARY ±.1° CONCENTRICITY BETWEEN ANY DIAMETERS ON THE SAME CENTERLINE SHALL NOT EXCEED .010 TOTAL INDICATOR READING. ALL DIMENSIONS ARE FINISH DIMENSIONS INCLUDING APPLIED FINISH AND ARE GIVEN IN INCHES.								
APPLICATION		SM-D-249244		SM-D-249244		SM-D-249098		